

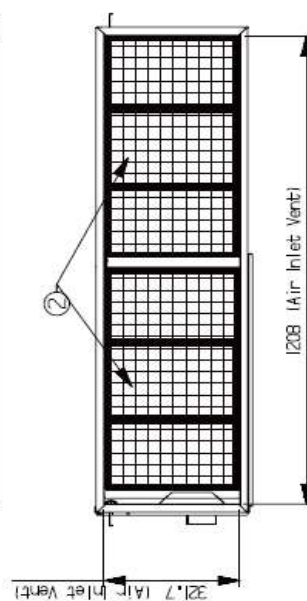
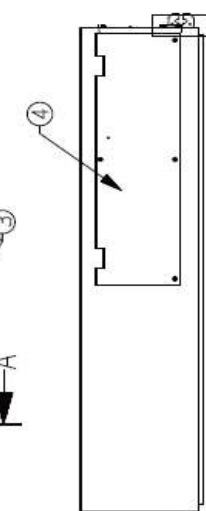
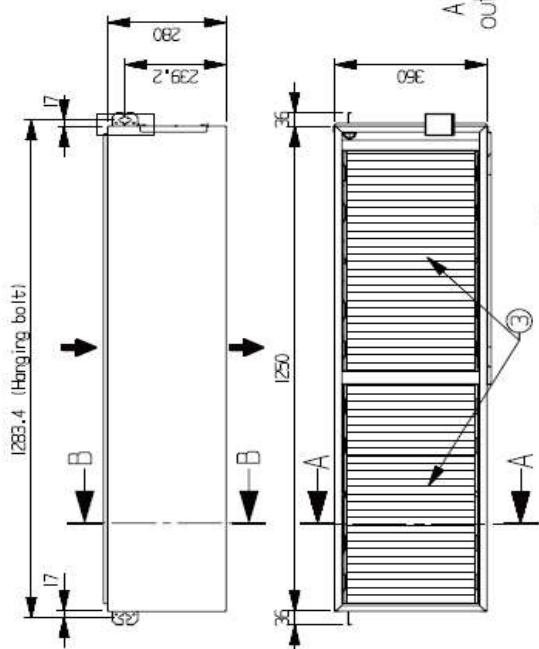
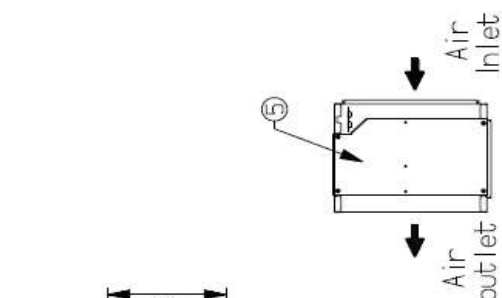



[Unit: mm]
DWG No. T1

SECTION B-B



SECTION A-A

Symbols



Note

1. Unit should be installed in compliance with the installation manual in the product box.
2. Unit should be grounded in accordance with the local regulations or applicable national codes.
3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.

5	Side Panel	For Service
4	Lower Panel	For Service
3	Filter (ZEAL)	Replacement (MERV13, ePM 65%)
2	Pre Filter (ZEAL)	Reusable
1	UV Module	-
No.	Part Name	Description