
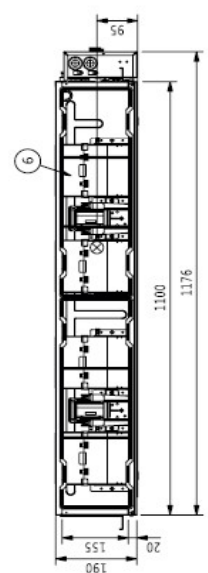
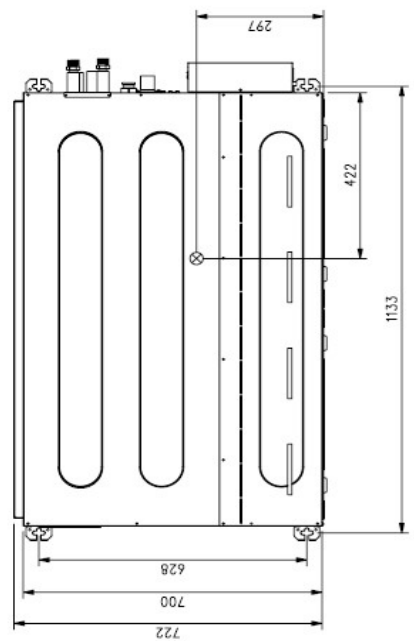
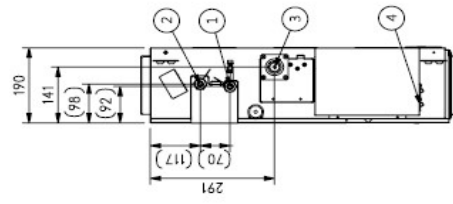
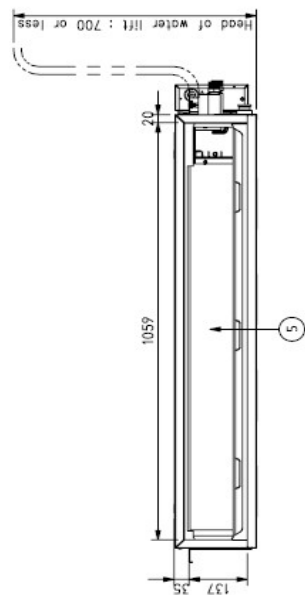


FAN COILY - Kanálová jednotka nízkotlaká **WFCA039~066RG0A**

[Unit: mm]
Chassis Code : L3
DWG No. : TBB36373301_Rev.00

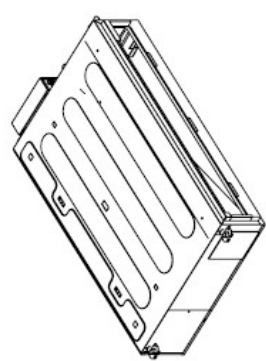

6	Air Suction	—	
5	Air discharge	—	
4	Power supply connection	—	
3	Drain pipe connection	—	
2	Water in pipe connection	PF(BSPF G) 3/4", Male	
1	Water out pipe connection	PF(BSPF G) 3/4", Male	
No.	Part Name		Description

Note
1. Unit should be installed in compliance with the installation manual in the product box.
2. Unit should be grounded in accordance with the local regulations or applicable national codes.
3. All electrical components and materials to be supplied by others must comply with the local regulations or international codes.