

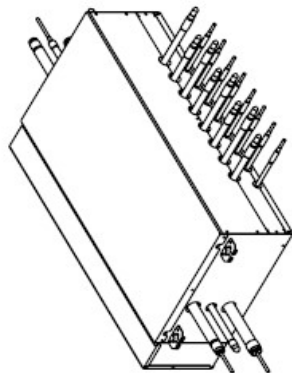
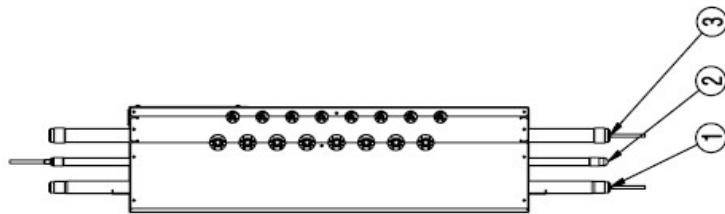


[Unit: mm]

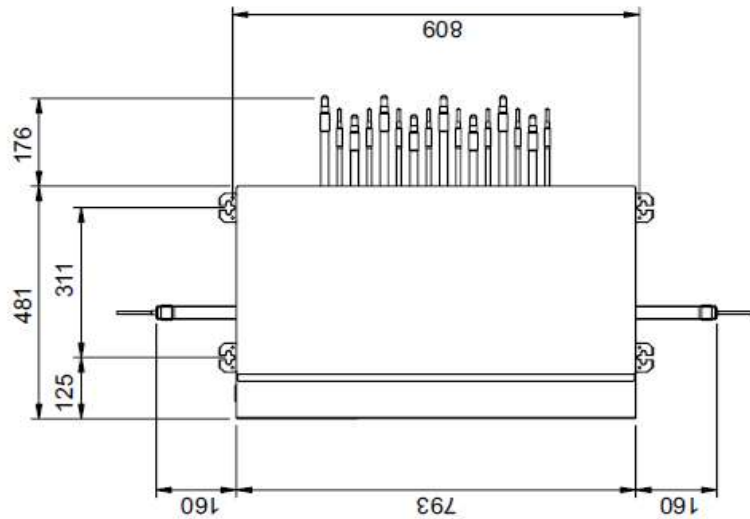

Note

- 1. Unit should be installed in compliance with the installation manual in the product box.
- 2. Unit should be grounded in accordance with the local regulations or applicable national codes.
- 3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.

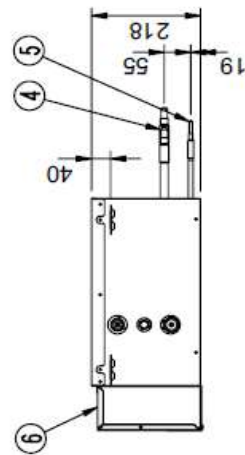

6	Control box	-
5	Liquid pipe to Indoor unit	8- \varnothing 9.52 - \varnothing 6.35
4	Gas pipe to Indoor unit	8- \varnothing 15.88 - \varnothing 12.7
3	Low pressure gas pipe	2- \varnothing 28.58
2	Liquid pipe to Outdoor unit	2- \varnothing 15.88
1	High pressure gas pipe	2- \varnothing 22.2
No.	Part Name	Description